987654327

DETAIL TO BE READ IN CONJUNCTION WITH SPECIFICATIONS

ALL MEASUREMENTS ARE IN MILLIMETERS UNLESS STATED OTHERWISE

DETAIL TO BE READ IN CONJUNCTION WITH GEOTECHNICAL REPORT AND ADJUSTED PER RECOMMENDATIONS

CONTRACTOR TO MAINTAIN WOOD FIBER LEVEL UNTIL FINAL ACCEPTANCE.

REPAIR AND RESTORE ANY DAMAGE TO EXISTING CONDITIONS.

ENSURE A CLEAN, FLUSH TRANSITION BETWEEN CONCRETE CURB AND ADJACENT MATERIALS. MAXIMUM VERTICAL CHANGE IN LEVEL IS 6mm.


ALL EXPOSED FACES OF CONCRETE TO BE BROOM FINISH, RUNNING PARALLEL TO LENGTH OF CURB.

CONCRETE FORMS AND LAYOUT TO BE APPROVED BY CONTRACT ADMINISTRATOR PRIOR TO POURING CONCRETE.

ALL CONCRETE TO HAVE A COMPRESSIVE STRENGTH OF 32MPa @ 28 DAYS.

SAFETY SURFACING TO COMPLY WITH CURRENT EDITIONS OF CAN/CSA-Z614, ASTM F1951 AND F2075.

SAFETY SURFACING TO BE INSTALLED AND COMPACTED PER MANUFACTURERS INSTRUCTIONS.

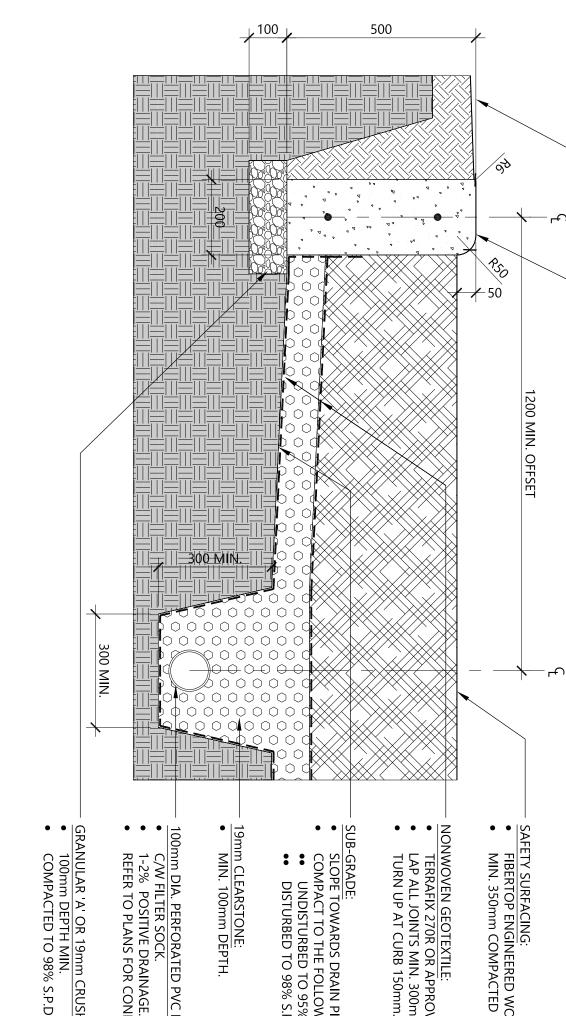

SAFETY SURFACING:

CAST IN PLACE CONCRETE CURB:
REINFORCED WITH (2) -15M REBAR CONTINUOUS. SAW CUT JOINTS AT 3650mm O.C.

FINISHED GRADE:

REFER TO PLANS FOR MATERIAL.

- MIN. 350mm COMPACTED DEPTH. FIBERTOP ENGINEERED WOOD FIBRE OR APPROVED EQUAL
- LAP ALL JOINTS MIN. 300mm.
- NONWOVEN GEOTEXTILE: TERRAFIX 270R OR APPROVED EQUAL.

SUB-GRADE:

- SLOPE TOWARDS DRAIN PIPE.
 COMPACT TO THE FOLLOWING, AS APPLICABL UNDISTURBED TO 95% S.P.D.

Ë

DISTURBED TO 98% S.P.D.

19mm CLEARSTONE: MIN. 100mm DEPTH

100mm DIA. PERFORATED PVC DRAIN PIPE:

- C/W FILTER SOCK.
- 1-2% POSITIVE DRAINAGE.
- REFER TO PLANS FOR CONNECTION POINT.
- GRANULAR 'A' OR 19mm CRUSHER RUN LIMESTOI

- ΙË
- 100mm DEPTH MIN.

