


**SCHEMATIC SITE PLAN - 4.30m WIDE PATIO FROM CURB**

SCALE 1:100


**NOTES:**

- PATIO MAY EXTEND THE WIDTH OF THE BUSINESS UNIT IN ADDITION TO UTILIZING A PORTION OF THE SIDEWALK IF THE SIDEWALK EXCEEDS 1830mm IN WIDTH.
- TABLES MAY BE PLACED DIRECTLY ON ASPHALT WITH NO DECK STRUCTURE, PROVIDED AN ACCESSIBLE RAMP IS CONSTRUCTED, SEE RAMP DETAIL.




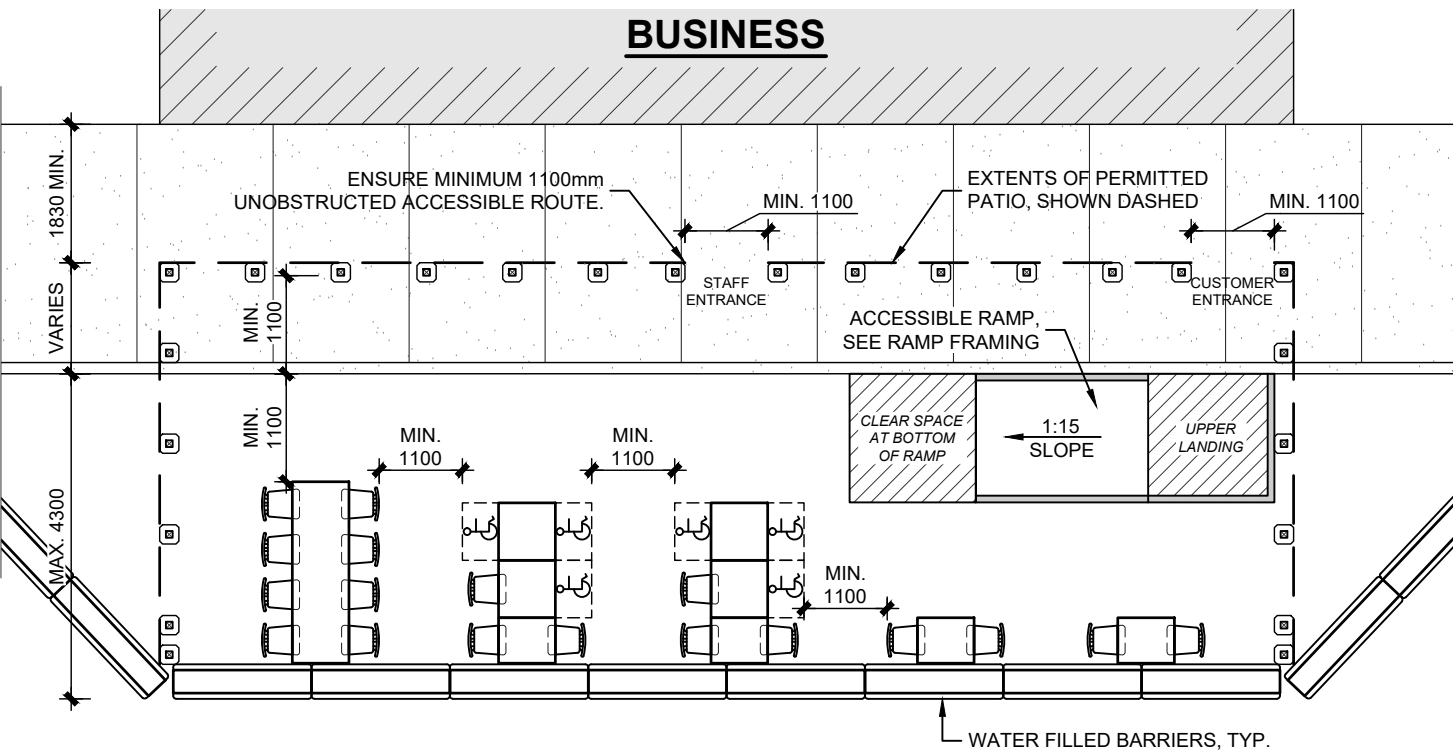

**PATIO LAYOUT EXAMPLE 1 - 4.30m WIDE PATIO ON ASPHALT**  
SCALE 1:100

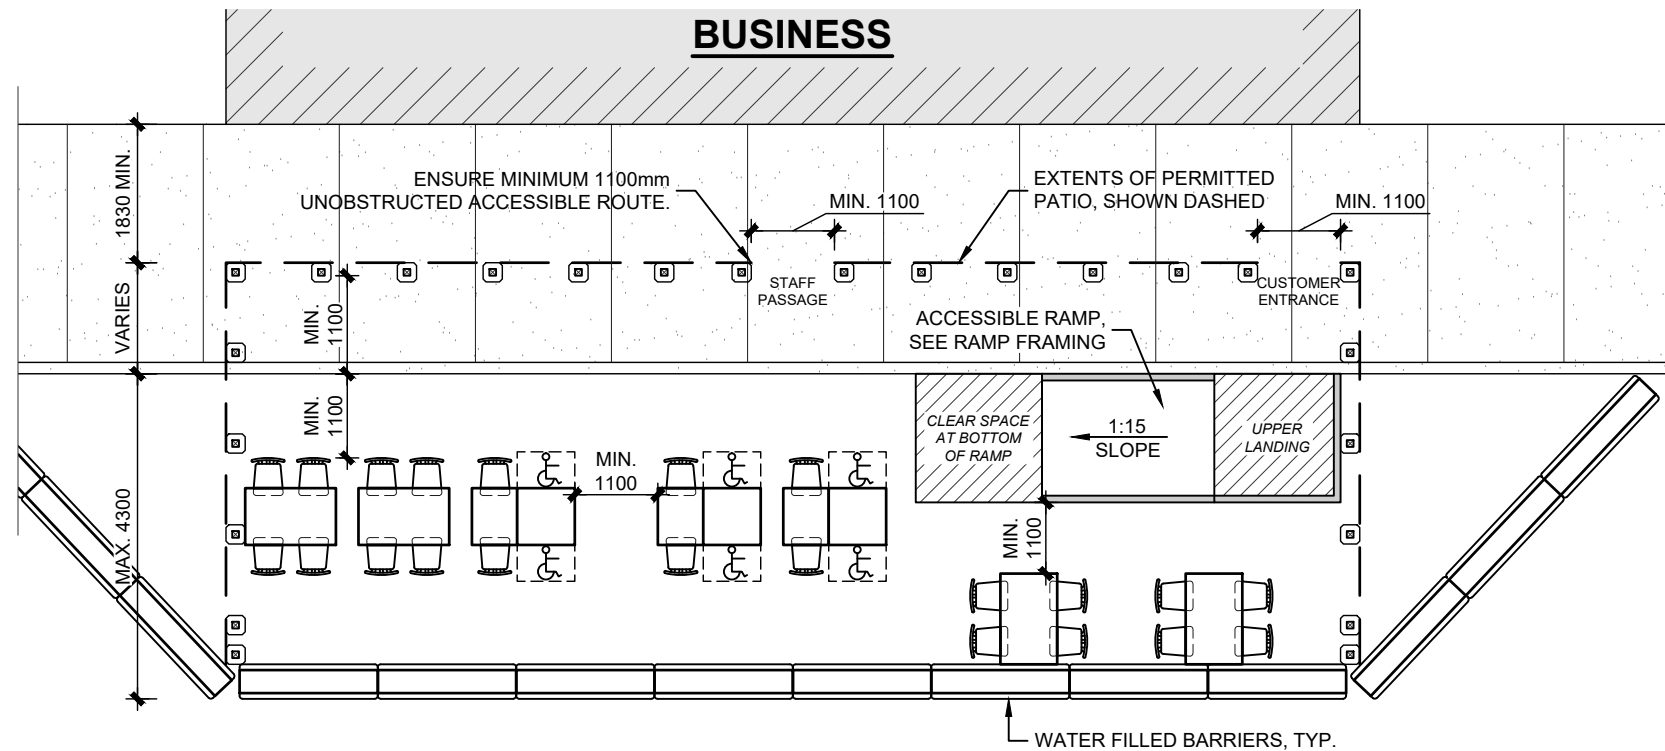

**PATIO LAYOUT EXAMPLE 2 - 4.30m WIDE PATIO ON ASPHALT (ALTERNATE LAYOUT)**  
SCALE 1:100

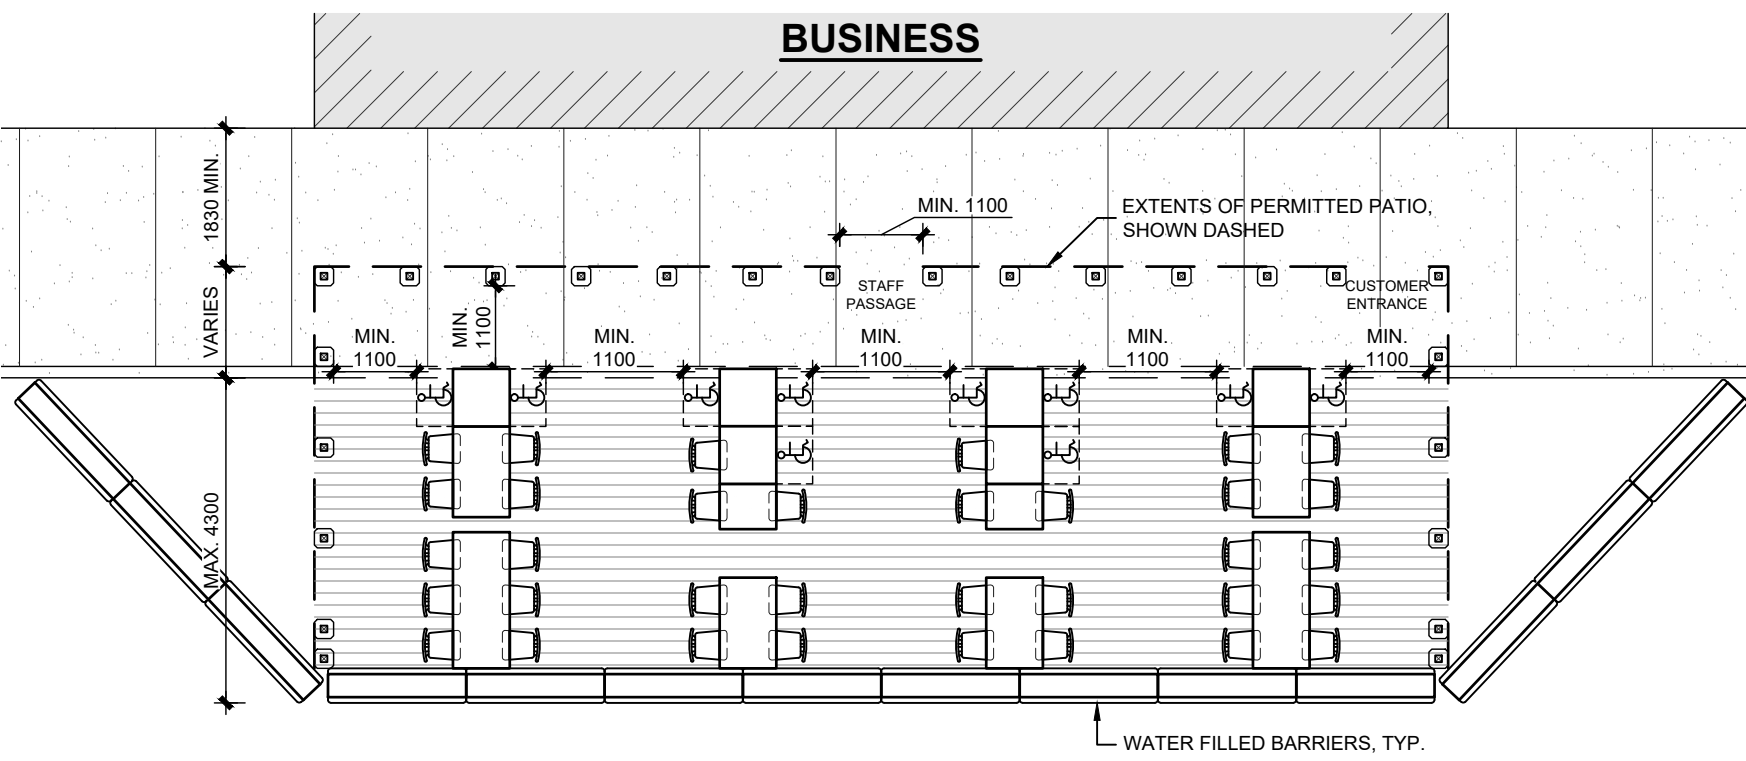


**PATIO LAYOUT EXAMPLE 3 - 4.30m WIDE PATIO ON DECK PLATFORM**  
SCALE 1:100


**PATIO LAYOUT NOTES:**

- PATIOS TO BE DELINEATED BY A CONTINUOUS FENCE WITHIN PERMITTED PATIO AREA, SEE FENCE DETAILS.
- TABLE LAYOUT, RAMP LOCATION AND ENTRANCE LOCATION CAN BE REARRANGED AS PREFERRED PROVIDED ALL CLEARANCES ARE MET, SEE EXAMPLES.
- ENSURE MINIMUM 1100mm UNOBSTRUCTED ACCESSIBLE ROUTE.
- SUBJECT TO REVIEW BY BUILDING DEPARTMENT, AND CAPACITY OF EXISTING WASHROOMS TO SERVICE OVERALL CUSTOMERS/STAFF (INDOORS AND OUTDOORS), SEATING LAYOUT MAY NEED TO BE ALTERED.

**ACCESSIBLE SEATING:**

- ACCESSIBLE SEATING PROVIDED AT TABLES SHALL HAVE A CLEAR SPACE OF 760mm x 480mm, TYPICAL.
- ACCESSIBLE SEATING TO BE MINIMUM 20% OF TOTAL PATIO SEATING.



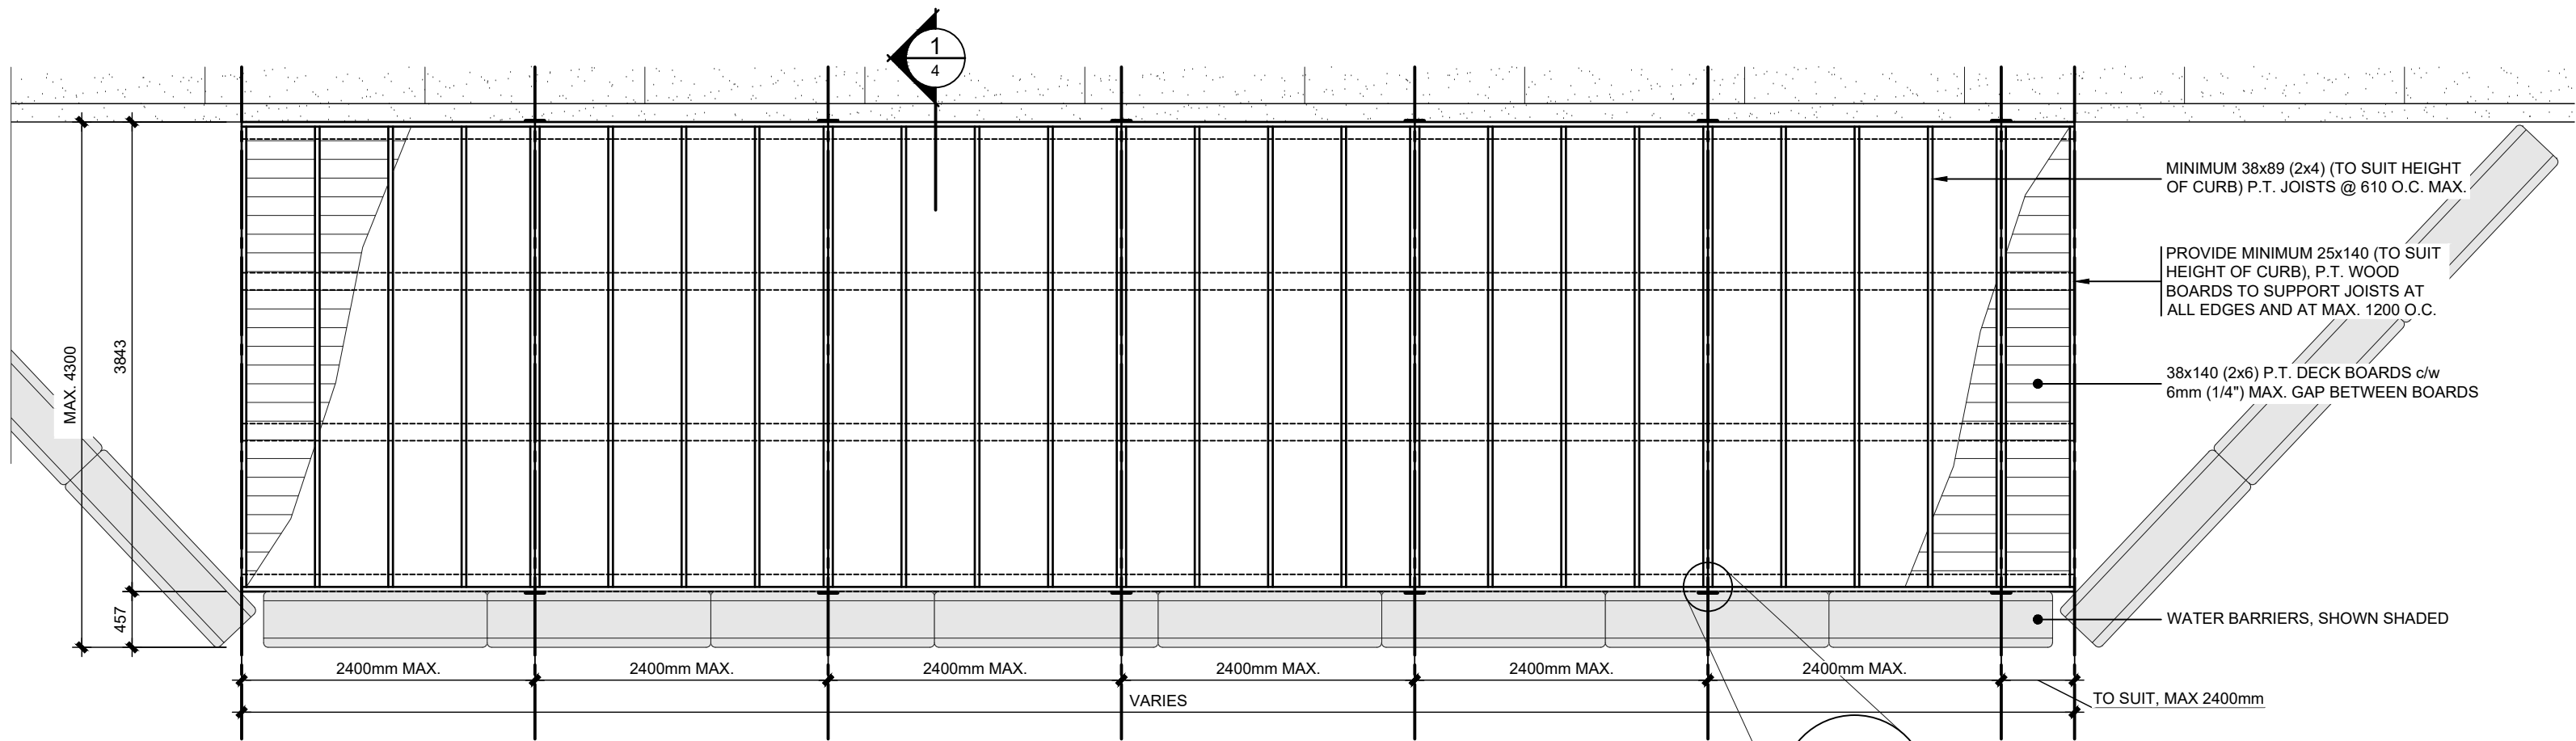

MINIMUM 38x89 (2x4) (TO SUIT HEIGHT OF CURB) P.T. JOISTS @ 610 O.C. MAX.

PROVIDE MINIMUM 25x140 (TO SUIT HEIGHT OF CURB), P.T. WOOD BOARDS TO SUPPORT JOISTS AT ALL EDGES AND AT MAX. 1200 O.C.

38x140 (2x6) P.T. DECK BOARDS c/w 6mm (1/4\") MAX. GAP BETWEEN BOARDS

WATER BARRIERS, SHOWN SHADED



TO SUIT, MAX 2400mm

**DECK FRAMING PLAN - 4.30m PATIO NOTES:**

SCALE 1:50

DESIGN LOAD: LIVE LOAD = 4.8 kPa

- DECK FRAMING TO BE CONSTRUCTED IN 2400mm WIDE SECTIONS. AFTER SHIMMED AND LEVELED FASTEN SECTIONS TOGETHER w/ 16ga. x 150 x 90 GALVANIZED STEEL FACE PLATES c/w (8) - #8 x 76mm LONG SCREWS (4 INTO EACH PLATFORM)
- NAILS USED IN PRESSURE TREATED WOOD CONNECTIONS TO BE HOT DIPPED GALVANIZED TO ASTM A153. SCREWS USED IN PRESSURE TREATED WOOD TO BE HOT DIPPED GALVANIZED TO ASTM A153 OR POLYMER COATED.

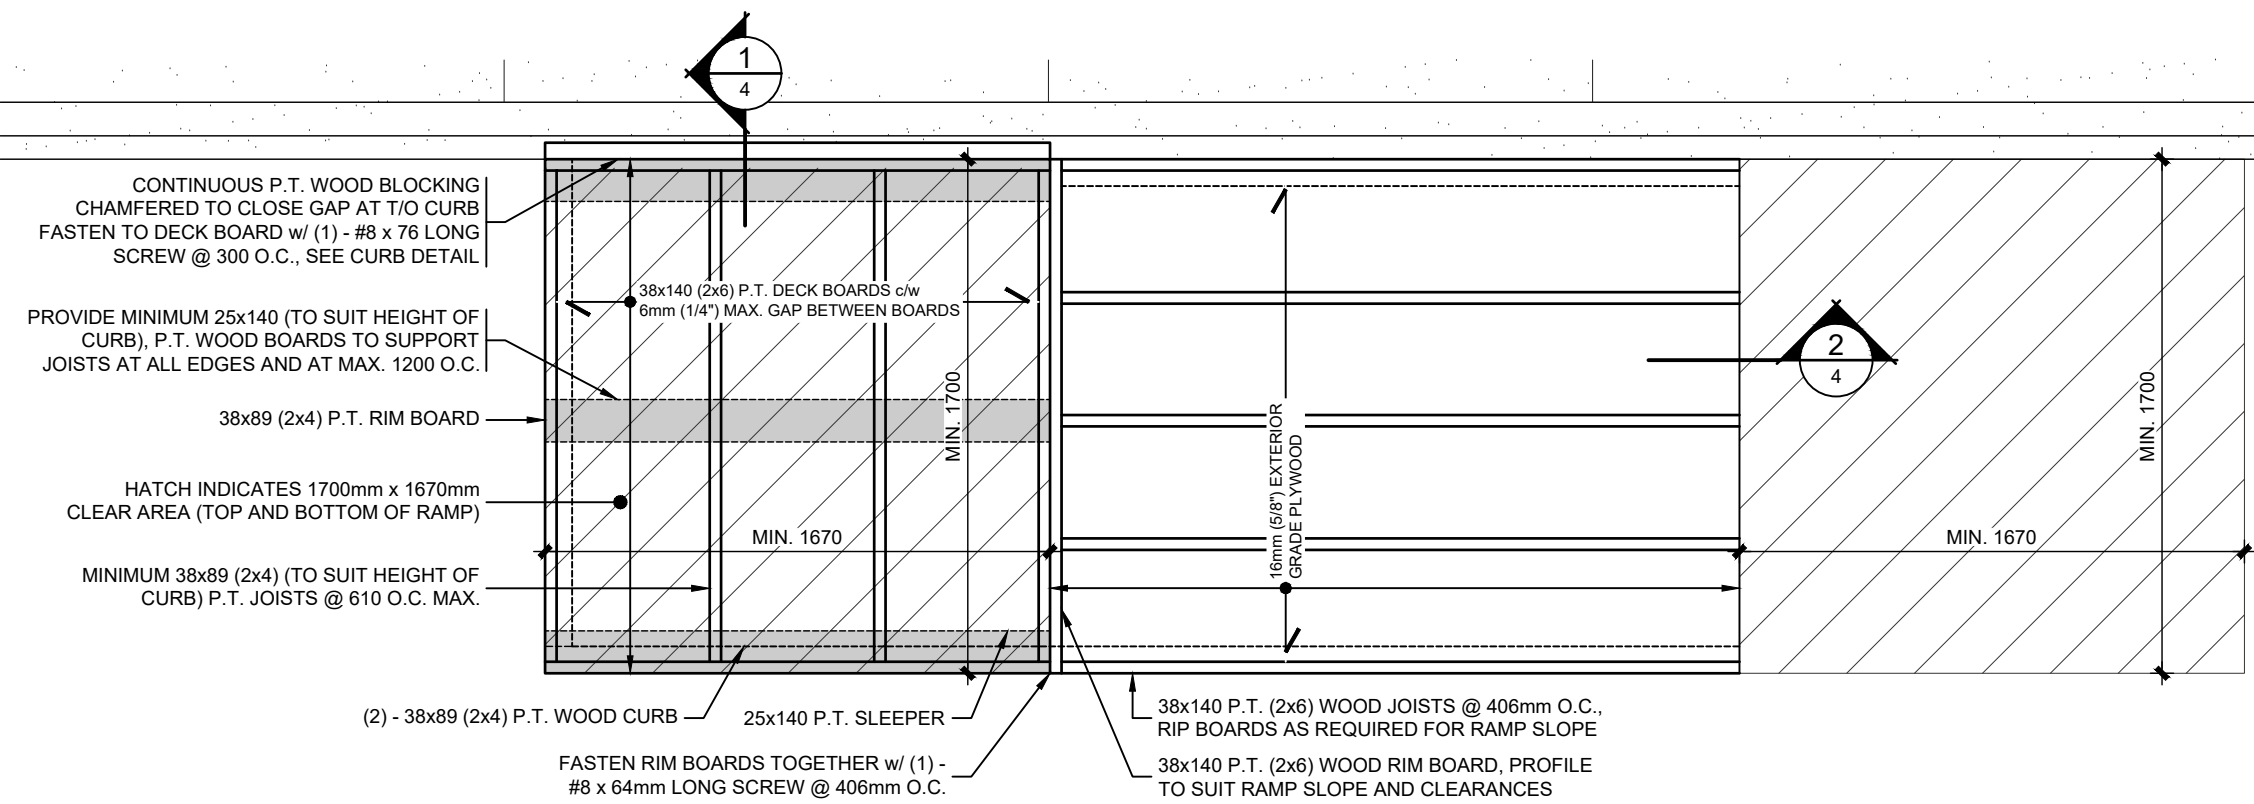

CONTINUOUS P.T. WOOD BLOCKING CHAMFERED TO CLOSE GAP AT T/O CURB FASTEN TO DECK BOARD w/ (1) - #8 x 76 LONG SCREW @ 300 O.C., SEE CURB DETAIL

PROVIDE MINIMUM 25x140 (TO SUIT HEIGHT OF CURB), P.T. WOOD BOARDS TO SUPPORT JOISTS AT ALL EDGES AND AT MAX. 1200 O.C.

38x89 (2x4) P.T. RIM BOARD

HATCH INDICATES 1700mm x 1670mm CLEAR AREA (TOP AND BOTTOM OF RAMP)

MINIMUM 38x89 (2x4) (TO SUIT HEIGHT OF CURB) P.T. JOISTS @ 610 O.C. MAX.

(2) - 38x89 (2x4) P.T. WOOD CURB

25x140 P.T. SLEEPER

FASTEN RIM BOARDS TOGETHER w/ (1) - #8 x 64mm LONG SCREW @ 406mm O.C.

38x140 P.T. (2x6) WOOD JOISTS @ 406mm O.C., RIP BOARDS AS REQUIRED FOR RAMP SLOPE

38x140 P.T. (2x6) WOOD RIM BOARD, PROFILE TO SUIT RAMP SLOPE AND CLEARANCES

**NOTES:**

- RAMP SURFACE TO BE:
  - SLIP RESISTANT
  - DETECTABLE WARNING SURFACE WITH (PEEL AND STICK)
  - TEXTURE IS CONTRASTED WITH ADJACE (TAPE TOP AND BOTTOM)
  - A SMOOTH TRANSITION FROM THE RAMP ADJACENT SURFACES (MAX. 6.4mm (1/4\"))



**TYPICAL RAMP FRAMING**


SCALE 1:25

**TACOMA**  
ENGINEERS  
176 Speedvale Avenue West  
Guelph, Ontario N1H 1C3  
Tel: 519.763.2000  
www.tacomaengineers.com


**CITY OF Guelph**  
Making a Difference

4.30m PATIO DRAWING PACKAGE


SHEET 3

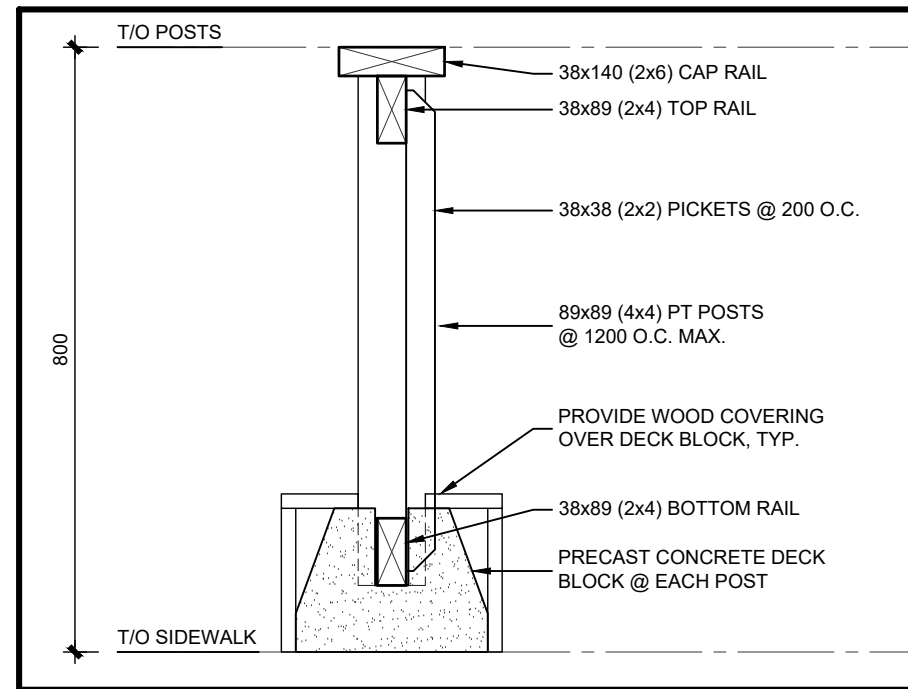


**DETAIL - WOOD FENCE**  
SCALE 1:10

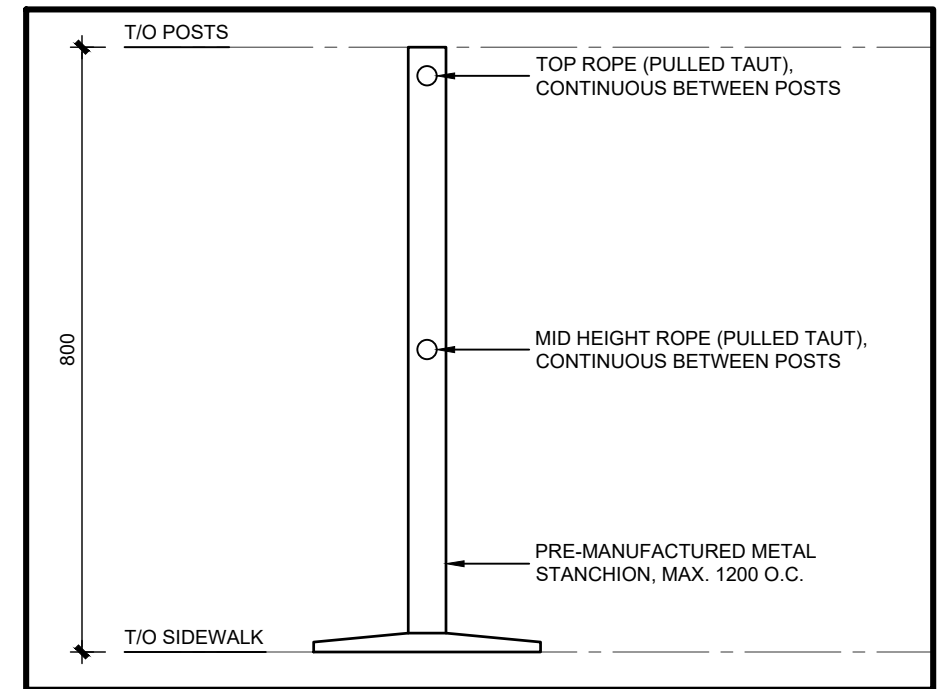

**DETAIL - METAL STANCHION w/ ROPE FENCE**  
SCALE 1:10

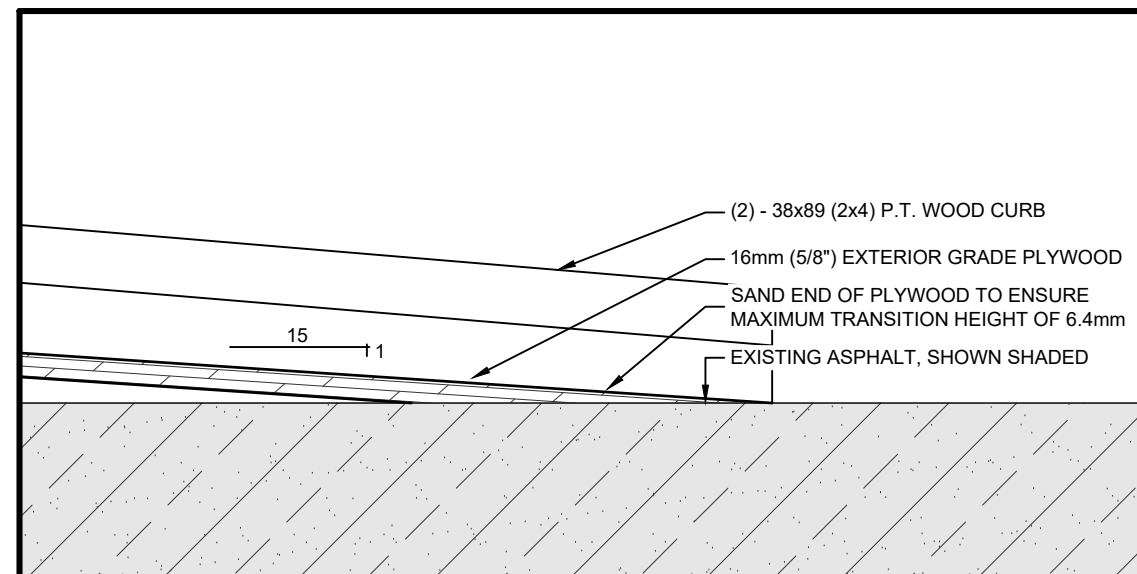

**2**  
**4** **DETAIL - BOTTOM RAMP TRANSITION**  
SCALE: 1:5

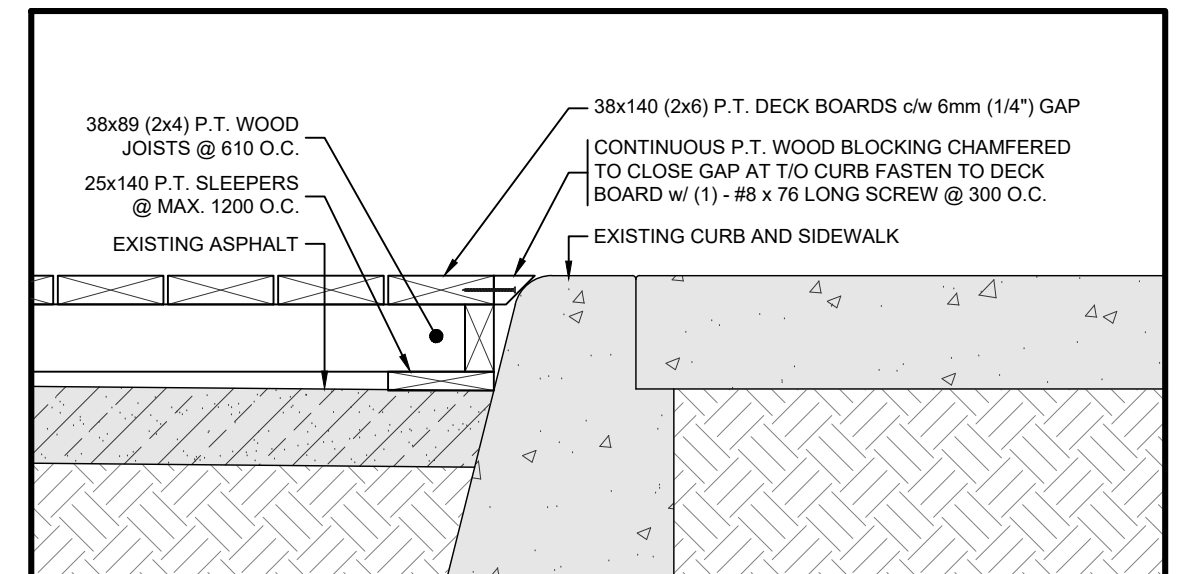

**1**  
**4** **SECTION - TYPICAL CURB TRANSITION**  
SCALE: 1:10